

## FIT<sup>1</sup>

UP TO 21.0 SEER2 & 10.0 HSPF2  
2 AND 3 TONS

### Contents

Nomenclature.....	2
Product Specifications.....	3
Expanded Cooling Data.....	4
Expanded Heating Data.....	8
Performance Data.....	10
Sound Data	
Sound Power.....	11
Quiet Mode.....	12
Sound Pressure.....	13
AHRI Ratings (see note).....	14
Dimensions.....	15
Wiring Diagrams.....	16
Accessories.....	17

DAIKIN FIT AURORA  
HIGH-EFFICIENCY, COMMUNICATING,  
VARIABLE-SPEED,  
INVERTER DRIVE SIDE DISCHARGE  
R-32 SPLIT SYSTEM HEAT PUMP



## R32

### Standard Features

- Daikin variable-speed swing compressor
- Strong heating capacity (Met the requirements of the U.S. Department of Energy (DOE) Residential Cold Climate Heat Pump Challenge)
- Suitable for high-ambient regions
- Quiet digitally commutated fan motor
- High-density compressor sound blanket
- Compatible with Daikin *One+* smart thermostat and other Daikin communicating equipment
- Daikin control algorithmic logic
- Compatible with AHRI 1380 Demand Response functionality
- Compatible with the *ONE* Ecosystem
- Intelligent Defrost Mode
- In communicating mode, only two low-voltage wires to outdoor unit required
- Diagnostic indicator lights, seven-segment LED display, and fault code storage
- Daikin Inside intelligence for diagnostics
- Quiet-mode - provides enhanced acoustical comfort, up to 3 different sound levels (as low as 47dBA)
- Field-selectable boost mode increases compressor speed during unusually high loads
- Field-installed bi-flow filter drier
- Coil and ambient temperature sensors
- Suction pressure transducer
- Sweat connection service valves with easy access to gauge ports
- Advanced water-shedding drain pan
- 3-Stage Heater Kit Available as a Field Installed Option
- Built-in drain pan heater
- Hot start technology
- AHRI Certified; ETL Listed

### Cabinet Features

- Heavy-gauge galvanized steel cabinet with grille-style sound control side design
- Custom Ivory white powder-paint finish
- 500-hour salt-spray tested
- High corrosion (ZAM®), unpainted steel bottom frame and legs
- Wire fan discharge grille
- Top and side maintenance access
- When properly anchored, meets the 2023 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)




Products that are recognized as the Most Efficient of ENERGY STAR® in 2025 prevent greenhouse gas emissions by meeting rigorous energy efficiency performance levels set by the U.S. Environmental Protection Agency.









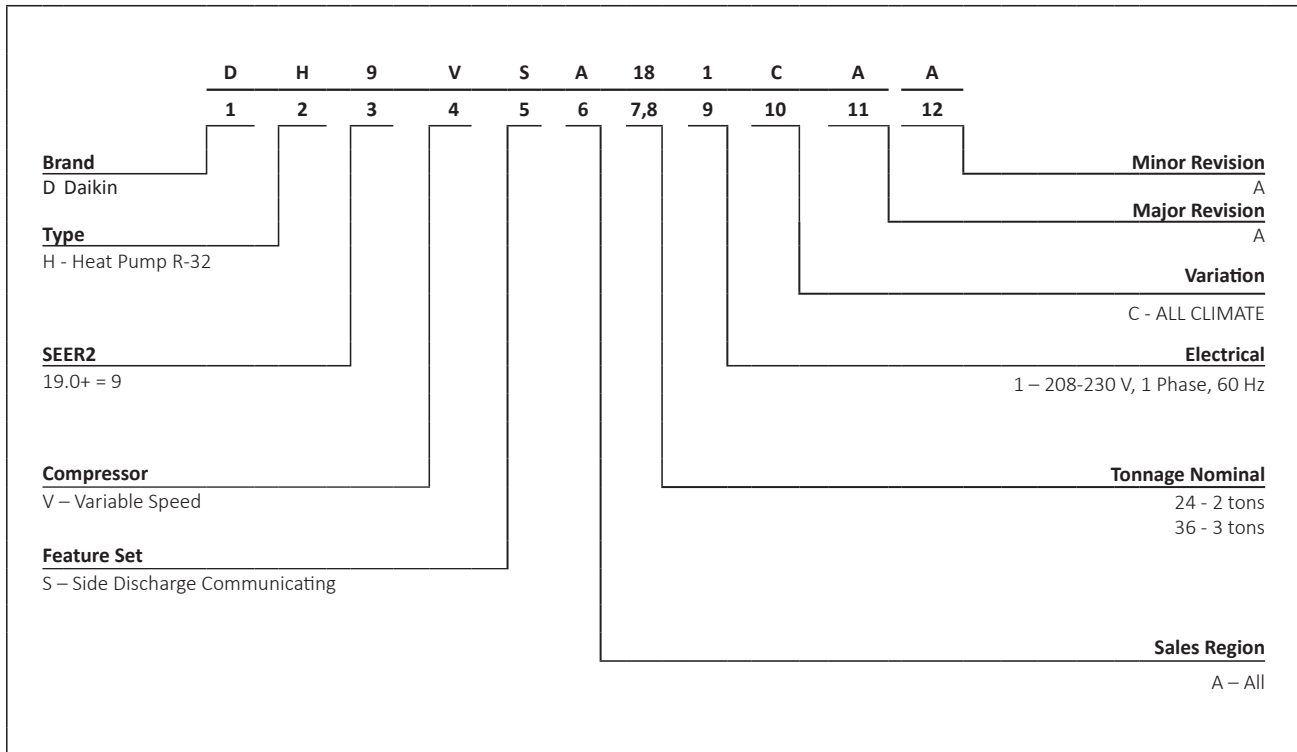

\* Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR criteria. Ask your contractor for details or visit [www.energystar.gov](http://www.energystar.gov).

Eligible for IRA Tax Credit  
(Meets New CEE 2025 Specification)



\* Complete warranty details available from your local dealer or at [www.daikincomfort.com](http://www.daikincomfort.com). To receive the 12-Year Unit Replacement Limited Warranty and 12-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Additional requirements for annual maintenance are required for the Unit Replacement Limited Warranty. Online registration and some of the additional requirements are not required in Florida, California, or Québec. The duration of warranty coverage in Texas and Florida differs in some cases. Other limitations and exclusions apply; refer to complete warranty details for a full list of limitations and exclusions. Online registration and some of the additional requirements are not required in California or Québec. The duration of warranty coverage in Texas and Florida differs in some cases.



	DH9VSA 241CA*	DH9VSA 361CA*
<b>CAPACITIES (AHRI RATED)</b>		
Max. Cooling (BTU/h)-95F	24,000	36,000
Max. Heating (BTU/h)-47F	24,000	36,000
Max. Heating (BTU/h)-5F	24,000	36,000
<b>AMBIENT OPERATION RANGE</b>	0 to 115 (-17.8 to 46.1)	
Cooling (°FDB(°CDB))	-10 to 70 (-23.3 to 21.1)	
Heating (°FDB(°CDB))		
<b>COMPRESSOR</b>		
Type	Swing	Swing
<b>CONDENSER FAN MOTOR</b>		
Horsepower	0.20	0.36
<b>REFRIGERATION SYSTEM</b>		
Refrigerant Line Size <sup>1</sup>		
Liquid Line Size ("O.D.)	3/8"	3/8"
Suction Line Size ("O.D.)	7/8"	7/8"
Refrigerant Connection Size		
Liquid Valve Size ("O.D.)	3/8"	3/8"
Suction Valve Size ("O.D.)	7/8"	7/8"
Valve Connection Type	Front and Back Sealing	Front and Back Sealing
Refrigerant Charge (oz.)	162	162
Expansion Device	EEV	EEV
Superheat at Service Valve	Auto-control	Auto-control
Subcooling at Service Valve	11±1°F	9±1°F
<b>ELECTRICAL DATA</b>		
Voltage / Phase (60 Hz)	208-230/1	208-230/1
Fan/Compressor Inverter Drive Input	8.0	12.0
Minimum Circuit Ampacity <sup>2</sup>	17.4	21.8
Max. Overcurrent Protection <sup>3</sup>	20	25
Min / Max Volts	197/253	197/253
Electrical Conduit Size	1/2" or 3/4"	1/2" or 3/4"
<b>EQUIPMENT WEIGHT (LBS)</b>	230	230
<b>SHIP WEIGHT (LBS)</b>	265	265
<b>ENERGY STAR® CERTIFIED</b>	    	    

<sup>1</sup> Tested and rated in accordance with AHRI Standard 210/240

<sup>2</sup> Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

<sup>3</sup> Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

**NOTES**

- Always check the S&R plate for electrical data on the unit being installed.
- Installer will need to supply 3/8" to 1 1/4" adapters for suction line connections.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.

(See table below for allowable line set diameter)

**ENERGY STAR NOTES**

Proper sizing and installation of equipment is critical to achieving optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR criteria. Ask your contractor for details or visit [www.energystar.gov](http://www.energystar.gov). The [www.energystar.gov](http://www.energystar.gov) website provides up-to-date system combinations certified to meet ENERGY STAR requirements.

UNIT TONS	ALLOWABLE LINE SET DIAMETER				
	LIQUID		SUCTION		
	5/16"	3/8"	5/8"	3/4"	7/8"
2.0	X	X	X	X	X
3.0	X	X		X	X

x Allowable combination

OUTDOOR UNIT	DH9VS*361*A*	
INDOOR UNIT	D*96TC0403B / 0603B D*97MC0603B D*80TC0603B / 0803B D*96SC0603BU	TRIM MORE THAN 5% SETTINGS ARE INVALID. TRIMMED UP CFM MAKES MISS MATCHING ERROR.

EXPANDED COOLING DATA — DH9VSA241CA\* / CAHEA3630\*3A\*, MBVK16CH\*X00A\*

IDB*		OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
		ENTERING INDOOR WET BULB TEMPERATURE																							
		AIRFLOW																							
770	MBh	25.0	25.3	26.1	27.2	24.5	24.9	25.6	26.8	23.7	24.0	24.7	25.9	22.4	22.7	23.4	24.6	20.8	21.2	21.9	23.0	19.4	19.8	20.5	21.6
	S/T	0.63	0.54	0.40	0.39	0.63	0.55	0.41	0.40	0.65	0.57	0.43	0.42	0.67	0.59	0.45	0.44	0.69	0.61	0.47	0.46	0.74	0.66	0.52	0.51
	ΔT	20	18	15	14	20	18	14	14	19	18	14	14	19	17	14	14	18	17	13	14	19	17	14	15
	kW	1.26	1.26	1.26	1.27	1.47	1.47	1.46	1.47	1.70	1.70	1.70	1.71	1.97	1.97	1.96	1.97	2.27	2.27	2.26	2.28	2.63	2.63	2.62	2.64
	Amps	6.0	6.0	5.9	6.0	6.7	6.7	6.7	6.7	7.5	7.5	7.5	7.6	8.4	8.4	8.4	8.4	9.3	9.3	9.3	9.4	10.5	10.5	10.4	10.5
70	Hi-PR	218	219	221	225	257	258	260	264	299	300	301	306	345	346	347	351	395	396	397	400	450	451	452	457
	Lo-PR	129	133	140	145	133	137	144	156	136	140	147	152	137	141	148	159	138	142	149	153	140	143	151	153
	MBh	25.4	25.7	26.5	27.6	24.9	25.3	26.0	27.2	24.0	24.4	25.1	26.3	22.7	23.1	23.8	25.0	21.2	21.5	22.3	23.4	19.8	20.1	20.9	22.0
	S/T	0.71	0.63	0.48	0.47	0.71	0.63	0.49	0.53	0.73	0.65	0.51	0.55	0.75	0.67	0.53	0.57	0.77	0.69	0.55	0.59	0.82	0.74	0.60	0.64
	ΔT	19	17	13	13	18	16	13	13	18	16	13	13	18	16	13	13	17	15	12	12	18	16	13	13
1040	kW	1.27	1.27	1.27	1.28	1.48	1.48	1.47	1.48	1.71	1.71	1.71	1.72	1.98	1.98	1.97	1.98	2.28	2.28	2.28	2.28	2.64	2.64	2.64	2.64
	Amps	6.0	6.0	6.0	6.0	6.8	6.8	6.7	6.8	7.6	7.6	7.6	7.6	8.4	8.4	8.4	8.4	9.4	9.4	9.4	9.4	10.5	10.5	10.5	10.5
	Hi-PR	221	222	223	225	260	260	262	264	301	302	304	306	347	348	350	352	397	398	400	402	452	453	455	457
	Lo-PR	132	135	143	145	135	139	147	156	138	142	149	152	139	143	150	159	140	144	151	153	142	145	153	155
	MBh	25.8	26.2	26.9	28.1	25.4	25.7	26.5	27.6	24.5	24.9	25.6	26.8	23.2	23.6	24.3	25.5	21.7	22.0	22.7	23.8	20.3	20.6	21.3	22.4
770	S/T	0.75	0.67	0.52	0.52	0.75	0.67	0.53	0.53	0.77	0.69	0.55	0.55	0.79	0.71	0.57	0.57	0.81	0.73	0.59	0.59	0.99	0.78	0.64	0.64
	ΔT	18	16	12	12	17	15	12	12	17	15	12	12	17	15	12	12	16	14	11	11	17	15	12	12
	kW	1.28	1.28	1.28	1.28	1.49	1.48	1.48	1.48	1.72	1.72	1.72	1.72	1.99	1.98	1.98	1.98	2.29	2.29	2.28	2.28	2.65	2.65	2.65	2.65
	Amps	6.1	6.0	6.0	6.0	6.8	6.8	6.8	6.8	7.6	7.6	7.6	7.6	8.5	8.5	8.5	8.5	9.4	9.4	9.4	9.4	10.5	10.5	10.5	10.5
	Hi-PR	223	224	225	225	262	263	264	264	303	304	306	306	349	350	352	352	400	401	402	402	454	455	457	457
75	Lo-PR	134	138	145	145	138	142	149	156	140	144	152	152	142	145	153	153	142	146	153	153	144	148	155	155
	MBh	25.0	25.3	26.1	27.2	24.5	24.9	25.6	26.8	23.7	24.0	24.8	25.9	22.4	22.7	23.4	24.6	20.8	21.2	21.9	23.0	19.4	19.8	20.5	21.6
	S/T	0.76	0.68	0.54	0.39	1.00	0.69	0.54	0.39	1.00	0.71	0.57	0.42	1.00	0.73	0.58	0.44	1.00	0.75	0.61	0.46	0.99	0.80	0.66	0.51
	ΔT	24	22	19	15	24	22	18	15	23	22	18	15	23	21	18	14	22	20	17	14	23	21	18	15
	kW	1.26	1.26	1.26	1.27	1.47	1.46	1.46	1.47	1.70	1.70	1.70	1.71	1.97	1.96	1.96	1.97	2.27	2.27	2.26	2.28	2.63	2.63	2.62	2.64
70	Amps	6.0	6.0	5.9	6.0	6.7	6.7	6.7	6.7	7.5	7.5	7.5	7.6	8.4	8.4	8.4	8.4	9.3	9.3	9.3	9.4	10.5	10.4	10.4	10.5
	Hi-PR	219	220	221	225	257	258	260	264	299	300	302	306	345	346	347	351	395	396	398	402	450	451	452	457
	Lo-PR	129	133	140	152	133	137	144	156	136	140	147	158	137	141	148	159	138	142	149	160	140	144	151	162
	MBh	25.4	25.7	26.5	27.6	24.9	25.3	26.0	27.2	24.1	24.4	25.1	26.3	22.7	23.1	23.8	24.9	21.2	21.6	22.3	23.4	19.8	20.2	20.9	22.0
	S/T	0.84	0.76	0.62	0.47	1.00	0.77	0.62	0.47	1.00	0.79	0.65	0.50	1.00	0.81	0.66	0.51	1.00	0.83	0.68	0.54	0.99	0.88	0.74	0.59
70	ΔT	23	21	17	14	22	20	17	14	22	20	17	14	21	20	16	13	21	19	16	13	21	20	17	13
	kW	1.27	1.27	1.27	1.28	1.48	1.47	1.47	1.48	1.71	1.71	1.71	1.72	1.98	1.97	1.97	1.99	2.28	2.28	2.27	2.29	2.64	2.64	2.64	2.65
	Amps	6.0	6.0	6.0	6.0	6.8	6.7	6.7	6.8	7.6	7.6	7.5	7.6	8.4	8.4	8.4	8.5	9.4	9.4	9.4	9.4	10.5	10.5	10.5	10.5
	Hi-PR	221	222	223	227	260	261	262	266	301	302	304	308	347	348	350	354	397	398	400	404	452	453	455	459
	Lo-PR	132	135	143	154	135	139	147	158	138	142	149	161	139	143	150	162	140	144	151	162	142	145	153	164
1040	MBh	25.9	26.2	27.0	28.1	25.4	25.8	26.5	27.6	24.5	24.9	25.6	26.7	23.2	23.6	24.3	25.4	21.7	22.0	22.7	23.9	20.3	20.6	21.3	22.4
	S/T	1.00	0.80	0.66	0.51	1.00	0.81	0.66	0.51	1.00	0.83	0.69	0.54	1.00	0.85	0.70	0.55	1.00	0.87	0.72	0.57	0.99	0.92	0.77	0.63
	ΔT	22	20	16	13	21	19	16	13	21	19	16	13	20	19	15	12	20	18	15	12	20	19	16	12
	kW	1.28	1.28	1.27	1.29	1.48	1.48	1.48	1.49	1.72	1.72	1.72	1.73	1.99	1.98	1.98	1.99	2.29	2.29	2.28	2.30	2.65	2.65	2.64	2.66
	Amps	6.0	6.0	6.0	6.1	6.8	6.8	6.8	6.8	7.6	7.6	7.6	7.6	8.5	8.5	8.5	8.5	9.4	9.4	9.4	9.5	10.5	10.5	10.5	10.6
Hi-PR	223	224	226	229	262	263	264	268	304	305	306	310	349	350	352	356	400	401	402	406	455	456	457	461	
Lo-PR	134	138	145	157	138	142	149	161	140	144	152	163	142	146	153	164	142	146	153	165	144	148	155	166	

IDB\*: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Airflow may vary depending on actual ambient conditions and system operation modes.  
 Shaded area is ACCA (TVA) conditions  
 kW = Total system power  
 Amps = outdoor unit amps

EXPANDED COOLING DATA — DH9VSA241CA\* / CAHEA3630\*3A\*, MBVK16CH\*X00A\* (CONT.)

IDB*	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
<b>770</b>	MBh	25.1	25.5	26.2	27.4	24.7	25.0	25.8	26.9	23.8	24.2	24.9	26.0	22.5	22.8	23.6	24.7	21.0	21.3	22.0	23.1	19.6	19.9	20.6	21.7
	S/T	1.00	0.81	0.67	0.52	1.00	0.82	0.67	0.52	1.00	0.84	0.70	0.55	1.00	0.86	0.72	0.57	1.00	0.88	0.74	0.59	0.99	0.93	0.79	0.64
	ΔT	28	26	23	19	28	26	22	19	27	26	22	19	26	25	22	18	26	24	21	18	26	25	21	18
	kW	1.26	1.26	1.26	1.27	1.47	1.47	1.46	1.47	1.70	1.70	1.70	1.71	1.97	1.96	1.96	1.98	2.27	2.27	2.26	2.28	2.63	2.63	2.62	2.64
	Amps	6.0	6.0	5.9	6.0	6.7	6.7	6.7	6.7	7.5	7.5	7.5	7.6	8.4	8.4	8.4	8.4	9.3	9.3	9.3	9.4	10.5	10.5	10.4	10.5
	Hi PR	219	220	222	225	258	259	260	264	299	300	302	306	345	346	348	352	395	396	398	402	450	451	453	457
	Lo PR	130	134	141	152	134	138	145	156	136	140	148	159	138	142	149	160	138	142	149	161	140	144	151	162
	MBh	25.5	25.9	26.6	27.7	25.1	25.4	26.1	27.3	24.2	24.5	25.3	26.4	22.9	23.2	24.0	25.1	21.3	21.7	22.4	23.5	19.9	20.3	21.0	22.1
	S/T	1.00	0.89	0.75	0.60	1.00	0.90	0.75	0.60	1.00	0.92	0.78	0.63	1.00	0.94	0.80	0.65	1.00	0.96	0.82	0.67	0.99	0.99	0.87	0.72
	ΔT	27	25	22	18	26	24	21	18	26	24	21	17	25	23	20	17	24	23	20	16	25	23	20	17
kW	1.27	1.27	1.27	1.28	1.48	1.48	1.47	1.48	1.71	1.71	1.71	1.72	1.98	1.98	1.98	2.01	2.28	2.28	2.28	2.29	2.64	2.64	2.64	2.65	
Amps	6.0	6.0	6.0	6.1	6.8	6.8	6.7	6.8	7.6	7.6	7.6	7.6	8.4	8.4	8.4	8.5	9.4	9.4	9.4	9.4	10.5	10.5	10.5	10.5	
Hi PR	221	222	224	228	260	261	263	267	302	303	304	308	348	349	350	354	398	399	401	405	453	454	455	459	
Lo PR	132	136	143	155	136	140	147	159	139	143	150	161	140	144	151	162	140	144	152	163	142	146	153	164	
MBh	26.0	26.3	27.1	28.2	25.5	25.9	26.6	27.8	24.7	25.0	25.7	26.9	23.3	23.7	24.4	25.5	21.8	22.1	22.9	24.0	20.4	20.7	21.5	22.6	
S/T	1.00	0.94	0.79	0.64	1.00	0.94	0.79	0.64	1.00	0.96	0.82	0.67	1.00	0.98	0.84	0.69	1.00	1.00	0.85	0.71	0.99	0.99	0.90	0.76	
ΔT	26	24	20	17	25	23	20	17	25	23	20	16	24	22	19	16	23	22	19	15	24	22	19	16	
kW	1.28	1.28	1.28	1.29	1.48	1.48	1.48	1.49	1.72	1.72	1.72	1.73	1.99	1.98	2.01	2.02	2.29	2.29	2.28	2.30	2.65	2.65	2.65	2.66	
Amps	6.1	6.0	6.0	6.1	6.8	6.8	6.8	6.8	7.6	7.6	7.6	7.6	8.5	8.5	8.5	8.5	9.4	9.4	9.4	9.5	10.5	10.5	10.5	10.6	
Hi PR	224	224	226	230	262	263	265	269	304	305	307	311	350	351	352	356	400	401	403	407	455	456	458	462	
Lo PR	135	139	146	158	139	143	150	162	141	145	152	164	142	146	153	165	143	147	154	165	144	148	155	167	
<b>770</b>	MBh	25.5	25.9	26.6	27.8	25.1	25.4	26.2	27.3	24.2	24.6	25.3	26.4	22.9	23.3	24.0	25.1	21.4	21.7	22.4	23.5	20.0	20.3	21.0	22.1
	S/T	1.00	1.00	0.78	0.63	1.00	1.00	0.78	0.63	1.00	1.00	0.81	0.65	1.00	1.00	0.82	0.67	1.00	1.00	0.84	0.69	0.99	0.99	0.89	0.74
	ΔT	32	30	26	23	31	29	26	22	31	29	26	22	30	28	25	22	29	27	24	21	29	28	25	22
	kW	1.26	1.26	1.26	1.27	1.47	1.47	1.47	1.48	1.71	1.70	1.70	1.71	1.97	1.97	1.97	1.98	2.27	2.27	2.27	2.28	2.63	2.63	2.63	2.64
	Amps	6.0	6.0	6.0	6.0	6.7	6.7	6.7	6.8	7.5	7.5	7.5	7.6	8.4	8.4	8.4	8.4	9.4	9.4	9.4	9.4	10.5	10.5	10.5	10.5
	Hi PR	220	221	223	226	259	260	261	265	301	301	303	307	346	347	349	353	397	398	399	403	451	452	454	458
	Lo PR	132	136	143	155	136	140	147	159	138	142	150	161	139	143	151	162	140	144	151	162	142	146	153	164
	MBh	25.9	26.3	27.0	28.2	25.5	25.8	26.6	27.7	24.6	25.0	25.7	26.8	23.3	23.6	24.4	25.5	21.7	22.1	22.8	23.9	20.3	20.7	21.4	22.5
	S/T	1.00	1.00	0.86	0.71	1.00	1.00	0.86	0.71	1.00	1.00	0.88	0.73	1.00	1.00	0.90	0.75	1.00	1.00	0.92	0.77	0.99	0.99	0.97	0.82
	ΔT	30	29	25	22	30	28	25	21	29	28	24	21	29	27	24	20	28	26	23	20	28	27	23	20
kW	1.27	1.27	1.27	1.28	1.48	1.48	1.48	1.49	1.72	1.71	1.71	1.72	1.98	1.98	2.02	2.03	2.28	2.28	2.28	2.29	2.64	2.64	2.64	2.65	
Amps	6.0	6.0	6.0	6.1	6.8	6.8	6.8	6.8	7.6	7.6	7.6	7.6	8.5	8.4	8.4	8.5	9.4	9.4	9.4	9.4	10.5	10.5	10.5	10.6	
Hi PR	222	223	225	229	261	262	264	268	303	304	305	309	349	350	351	355	399	400	402	406	454	455	456	461	
Lo PR	134	138	145	157	138	142	149	161	140	144	152	163	142	146	153	164	142	146	153	165	144	148	155	166	
MBh	26.4	26.8	27.5	28.7	26.0	26.3	27.0	28.2	25.1	25.4	26.2	27.3	23.8	24.1	24.8	25.9	22.2	22.6	23.3	24.4	20.8	21.1	21.9	23.0	
S/T	1.00	1.00	0.90	0.75	1.00	1.00	0.90	0.75	1.00	1.00	0.92	0.77	1.00	1.00	0.94	0.79	1.00	1.00	0.96	0.81	0.99	0.99	0.99	0.86	
ΔT	29	27	24	20	29	27	24	20	28	27	23	20	28	26	23	19	27	25	22	19	27	26	22	19	
kW	1.28	1.28	1.28	1.29	1.49	1.49	1.48	1.50	1.72	1.72	1.72	1.73	1.99	1.99	2.03	2.04	2.29	2.29	2.29	2.30	2.65	2.65	2.65	2.66	
Amps	6.1	6.1	6.0	6.1	6.8	6.8	6.8	6.8	7.6	7.6	7.6	7.7	8.5	8.5	8.5	8.5	9.4	9.4	9.4	9.5	10.6	10.5	10.5	10.6	
Hi PR	225	225	227	231	263	264	266	270	305	306	308	312	351	352	354	358	401	402	404	408	456	457	457	463	
Lo PR	137	141	148	160	140	144	152	164	143	147	154	166	144	148	155	167	144	148	156	167	146	150	157	168	

kW = Total system power  
Amps = outdoor unit amps

Shaded area is AHRI conditions

IDB\*: Entering Indoor Dry Bulb Temperature  
High and low pressures are measured at the liquid and suction service valves.  
Airflow may vary depending on actual ambient conditions and system operation modes.

EXPANDED COOLING DATA — DH9VSA361CA\* / CAHEA3630\*3A\*, MBVK16CH\*X00A\*

IDB*	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
<b>1230</b>	MBh	36.8	37.3	38.4	35.8	36.3	37.3	34.1	34.6	35.7	31.9	32.4	33.4	29.4	29.8	30.9	27.1	27.5	28.5						
	S/T	0.67	0.58	0.43	0.66	0.58	0.43	0.68	0.60	0.45	0.69	0.61	0.46	0.70	0.62	0.48	0.74	0.66	0.52						
	ΔT	19	17	14	18	17	14	18	16	13	17	16	13	16	15	12	17	15	13						
	kW	1.92	1.92	1.91	2.19	2.19	2.19	2.50	2.50	2.50	2.85	2.84	2.84	3.23	3.23	3.23	3.69	3.69	3.69						
	Amps	7.6	7.6	7.5	8.7	8.7	8.7	9.9	9.9	9.9	11.3	11.3	11.3	12.8	12.8	12.8	14.7	14.7	14.7						
	Hi PR	241	242	244	283	284	285	327	328	330	375	376	378	428	429	431	485	486	488						
	Lo PR	128	132	139	134	136	143	135	139	146	136	140	147	137	140	147	138	142	149						
	MBh	37.4	37.9	39.0	36.3	36.8	37.9	34.7	35.2	36.2	32.4	32.9	33.9	29.9	30.4	31.4	27.6	28.1	29.1						
	S/T	0.75	0.67	0.51	0.75	0.66	0.51	0.76	0.68	0.53	0.77	0.69	0.54	0.78	0.70	0.56	0.82	0.74	0.60						
	ΔT	18	16	13	17	15	12	17	15	12	16	14	12	15	14	11	16	14	11						
kW	1.93	1.93	1.93	2.21	2.21	2.20	2.52	2.52	2.51	2.86	2.86	2.86	3.25	3.25	3.24	3.71	3.71	3.70							
Amps	7.6	7.6	7.6	8.7	8.7	8.7	10.0	10.0	10.0	11.4	11.4	11.3	12.9	12.9	12.9	14.8	14.7	14.7							
Hi PR	244	245	246	285	286	288	329	330	332	378	379	381	431	432	433	488	489	491							
Lo PR	130	134	142	134	138	145	137	141	148	138	142	149	139	142	150	140	144	151							
MBh	38.1	38.6	39.7	37.0	37.5	38.6	35.4	35.9	36.9	33.1	33.6	34.6	30.5	31.0	32.0	28.2	28.7	29.7							
S/T	0.80	0.71	0.56	0.79	0.70	0.55	0.80	0.72	0.57	0.81	0.73	0.58	0.82	0.74	0.60	0.86	0.78	0.64							
ΔT	17	15	12	16	14	11	16	14	11	15	14	11	14	13	10	15	13	11							
kW	1.95	1.95	1.94	2.22	2.22	2.21	2.53	2.53	2.53	2.87	2.87	2.87	3.26	3.26	3.26	3.72	3.72	3.72							
Amps	7.7	7.7	7.7	8.8	8.8	8.8	10.0	10.0	10.0	11.4	11.4	11.4	13.0	13.0	12.9	14.8	14.8	14.8							
Hi PR	246	247	249	288	289	290	332	333	335	380	381	383	433	434	436	490	491	493							
Lo PR	133	137	144	137	141	148	139	143	150	140	144	151	141	145	152	142	146	153							

<b>1230</b>	MBh	36.8	37.3	38.4	35.8	36.3	37.3	34.1	34.6	35.7	31.9	32.4	33.4	29.4	29.8	30.9	27.1	27.5	28.5
	S/T	0.81	0.73	0.57	0.81	0.72	0.57	1.02	0.74	0.59	1.00	0.75	0.60	0.98	0.76	0.61	0.96	0.80	0.66
	ΔT	23	21	18	22	20	17	22	20	17	21	19	16	20	18	15	20	19	16
	kW	1.92	1.92	1.91	2.19	2.19	2.19	2.50	2.50	2.50	2.84	2.84	2.84	3.23	3.23	3.23	3.69	3.69	3.69
	Amps	7.6	7.6	7.5	8.7	8.7	8.7	9.9	9.9	9.9	11.3	11.3	11.3	12.8	12.8	12.8	14.7	14.7	14.7
	Hi PR	241	243	244	283	284	286	327	328	330	375	376	378	428	429	431	485	486	488
	Lo PR	128	132	139	132	136	143	135	139	146	136	140	147	137	140	147	138	142	149
	MBh	37.4	37.9	39.0	36.3	36.8	37.9	34.7	35.2	36.3	32.4	32.9	33.9	29.9	30.4	31.4	27.6	28.1	29.1
	S/T	0.90	0.81	0.66	1.03	0.81	0.66	1.02	0.82	0.67	1.00	0.83	0.68	0.98	0.84	0.69	0.96	0.87	0.73
	ΔT	22	20	17	21	19	16	20	19	16	20	18	15	19	17	14	19	17	15
kW	1.93	1.93	1.93	2.21	2.21	2.20	2.52	2.52	2.51	2.86	2.85	2.87	3.25	3.25	3.24	3.71	3.71	3.70	
Amps	7.6	7.6	7.6	8.7	8.7	8.7	10.0	10.0	10.0	11.4	11.3	11.4	12.9	12.9	12.9	14.7	14.7	14.8	
Hi PR	244	245	247	285	286	288	330	331	332	378	379	381	431	432	434	488	489	491	
Lo PR	130	134	142	134	138	146	137	141	148	138	142	149	139	142	150	140	144	151	
MBh	38.1	38.6	39.7	37.0	37.5	38.6	35.4	35.9	36.9	33.1	33.6	34.6	30.6	31.0	32.1	28.3	28.7	29.7	
S/T	0.94	0.86	0.70	1.03	0.85	0.70	1.02	0.86	0.71	1.00	0.87	0.72	0.98	0.88	0.73	0.96	0.91	0.77	
ΔT	20	19	16	20	18	15	19	18	15	19	17	14	18	16	13	18	17	14	
kW	1.95	1.94	1.94	2.22	2.22	2.21	2.53	2.53	2.52	2.87	2.87	2.87	3.26	3.26	3.26	3.72	3.72	3.74	
Amps	7.7	7.7	7.7	8.8	8.8	8.8	10.0	10.0	10.1	11.4	11.4	11.4	13.0	12.9	12.9	14.8	14.8	14.9	
Hi PR	246	247	249	288	289	291	332	333	335	380	381	383	433	434	436	491	492	493	
Lo PR	133	137	144	137	141	148	139	143	150	140	144	151	141	145	152	142	146	153	

kW = Total system power  
Amps = outdoor unit amps

Shaded area is ACCA (TVA) conditions

IDB\*: Entering Indoor Dry Bulb Temperature  
High and low pressures are measured at the liquid and suction service valves.  
Airflow may vary depending on actual ambient conditions and system operation modes.

EXPANDED COOLING DATA — DH9VSA361CA\* / CAHEA3630\*3A\*, MBVK16CH\*X00A\* (CONT.)

IDB*	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																								
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
<b>1230</b>	MBh	37.0	37.5	38.6	40.3	36.0	36.5	37.6	39.2	34.3	34.8	35.9	37.5	32.1	32.6	33.6	35.2	29.6	30.0	31.1	32.6	27.3	27.7	28.7	30.3	
	S/T	1.00	0.87	0.72	0.55	1.00	0.86	0.71	0.55	1.00	0.87	0.73	0.57	1.00	0.88	0.73	0.58	0.98	0.89	0.75	0.59	0.96	0.93	0.79	0.64	
	ΔT	27	25	22	18	26	24	21	18	25	24	21	17	24	23	20	17	23	22	19	16	23	22	19	16	
	KW	1.92	1.92	1.91	1.93	2.19	2.19	2.19	2.21	2.50	2.50	2.50	2.52	2.85	2.84	2.84	2.86	3.23	3.23	3.23	3.25	3.69	3.69	3.69	3.71	
	Amps	7.6	7.6	7.5	7.6	8.7	8.7	8.7	8.7	9.9	9.9	9.9	10.0	11.3	11.3	11.3	11.3	12.8	12.8	12.8	12.9	14.7	14.7	14.7	14.7	
	Hi PR	242	243	245	249	283	284	286	290	328	329	330	335	376	377	379	383	429	430	431	436	486	487	489	493	
	Lo PR	129	133	140	151	133	137	144	155	135	139	146	158	136	140	147	159	137	141	148	159	139	143	150	160	
	<b>80</b>	MBh	37.6	38.1	39.2	40.9	36.5	37.0	38.1	39.8	34.9	35.4	36.4	38.1	32.6	33.1	<b>34.2</b>	35.7	30.1	30.6	31.6	33.1	27.8	28.3	29.2	30.8
		S/T	1.00	0.95	0.80	0.64	1.03	0.95	0.79	0.64	1.02	0.96	0.81	0.65	1.00	0.96	<b>0.82</b>	0.66	0.98	0.97	0.83	0.67	0.96	0.96	0.86	0.72
		ΔT	25	24	20	17	25	23	20	16	24	22	19	16	23	21	<b>18</b>	15	22	21	18	15	22	21	18	15
KW		1.93	1.93	1.93	1.95	2.21	2.21	2.20	2.22	2.52	2.52	2.51	2.53	2.85	2.85	<b>2.85</b>	2.87	3.25	3.25	3.24	3.26	3.71	3.71	3.70	3.72	
Amps		7.6	7.6	7.6	7.7	8.7	8.7	8.7	8.8	10.0	10.0	10.0	10.0	11.4	11.3	<b>11.3</b>	11.4	12.9	12.9	12.9	13.0	14.8	14.7	14.7	14.8	
Hi PR		244	245	247	251	286	287	289	293	330	331	333	337	378	379	<b>381</b>	386	431	432	434	439	488	490	491	496	
Lo PR		131	135	142	154	135	139	146	158	137	141	149	160	138	142	<b>150</b>	161	139	143	150	161	141	145	152	163	
<b>1670</b>		MBh	38.3	38.8	39.9	41.6	37.2	37.7	38.8	40.5	35.6	36.1	37.1	38.7	33.3	33.8	34.8	36.4	30.7	31.2	32.2	33.8	28.4	28.9	29.9	31.4
		S/T	1.00	1.00	0.84	0.68	1.00	0.99	0.84	0.68	1.02	1.00	0.85	0.69	1.00	1.00	0.86	0.70	0.98	0.98	0.87	0.71	0.96	0.96	0.90	0.75
		ΔT	24	23	19	16	24	22	19	15	23	21	18	15	22	20	18	14	21	20	17	14	21	20	17	14
	KW	1.95	1.94	1.94	1.96	2.22	2.22	2.21	2.23	2.53	2.53	2.53	2.54	2.87	2.87	2.87	2.89	3.26	3.26	3.26	3.28	3.72	3.72	3.72	3.74	
	Amps	7.7	7.7	7.7	7.7	8.8	8.8	8.8	8.8	10.0	10.0	10.0	10.1	11.4	11.4	11.4	11.5	13.0	13.0	12.9	13.0	14.8	14.8	14.8	14.9	
	Hi PR	247	248	250	254	288	289	291	295	332	334	335	340	381	382	384	388	434	435	437	441	491	492	494	498	
	Lo PR	134	138	145	156	137	141	149	160	140	144	151	163	141	145	152	163	141	145	152	164	143	147	154	165	
	<b>1230</b>	MBh	37.6	38.1	39.2	40.9	36.6	37.1	38.2	39.8	34.9	35.4	36.5	38.1	32.7	33.2	34.2	35.8	30.1	30.6	31.6	33.2	27.8	28.3	29.3	30.8
		S/T	1.00	0.98	0.83	0.67	1.00	1.00	0.82	0.66	1.00	1.00	0.84	0.68	1.00	1.00	0.84	0.69	0.98	0.98	0.85	0.70	0.96	0.96	0.89	0.74
		ΔT	30	28	25	22	29	27	24	21	28	27	24	21	27	26	23	20	26	25	22	19	26	25	22	19
KW		1.92	1.92	1.92	1.94	2.20	2.20	2.19	2.21	2.51	2.51	2.50	2.52	2.85	2.85	2.84	2.86	3.24	3.24	3.23	3.25	3.70	3.70	3.69	3.71	
Amps		7.6	7.6	7.6	7.6	8.7	8.7	8.7	8.8	9.9	9.9	9.9	10.0	11.3	11.3	11.3	11.4	12.9	12.9	12.8	12.9	14.7	14.7	14.7	14.8	
Hi PR		243	244	246	250	284	286	287	292	329	330	331	336	377	378	380	384	430	431	433	437	487	488	490	494	
Lo PR		131	135	142	153	135	138	146	157	137	141	148	160	138	142	149	160	139	143	150	161	140	144	151	162	
<b>85</b>		MBh	38.2	38.7	39.8	41.5	37.1	37.6	38.7	40.4	35.5	36.0	37.0	38.7	33.2	33.7	34.7	36.3	30.7	31.1	32.2	33.7	28.3	28.8	29.8	31.3
		S/T	1.00	1.05	0.92	0.75	1.00	1.03	0.91	0.75	1.02	1.02	0.92	0.76	1.00	1.00	0.92	0.77	0.98	0.98	0.93	0.78	0.96	0.96	0.96	0.82
		ΔT	29	27	24	20	28	26	23	20	27	26	23	19	26	25	22	19	25	24	21	18	25	24	21	18
	KW	1.94	1.94	1.93	1.95	2.21	2.21	2.21	2.23	2.52	2.52	2.52	2.54	2.87	2.86	2.86	2.88	3.26	3.25	3.25	3.27	3.72	3.71	3.71	3.73	
	Amps	7.7	7.7	7.6	7.7	8.8	8.8	8.7	8.8	10.0	10.0	10.0	10.1	11.4	11.4	11.4	11.4	12.9	12.9	12.9	13.0	14.8	14.8	14.7	14.8	
	Hi PR	246	247	248	252	287	288	290	294	331	332	334	338	380	381	382	387	432	434	435	440	490	491	493	497	
	Lo PR	133	137	144	156	137	141	148	160	139	143	150	162	140	144	151	163	141	145	152	163	142	146	153	164	
	<b>1670</b>	MBh	38.9	39.4	40.5	42.2	37.8	38.3	39.4	41.1	36.2	36.7	37.7	39.3	33.9	34.4	35.4	37.0	31.3	31.8	32.8	34.4	29.0	29.5	30.5	32.0
		S/T	1.00	1.05	0.96	0.80	1.00	1.00	0.95	0.79	1.00	1.00	0.96	0.80	1.00	1.00	0.97	0.81	0.98	0.98	0.97	0.82	0.96	0.96	0.96	0.86
		ΔT	28	26	23	19	27	25	22	19	26	25	22	18	25	24	21	18	24	23	20	17	24	23	20	17
KW		1.95	1.95	1.95	1.96	2.23	2.22	2.22	2.24	2.54	2.53	2.53	2.55	2.88	2.88	2.87	2.89	3.27	3.27	3.26	3.28	3.73	3.73	3.72	3.74	
Amps		7.7	7.7	7.7	7.8	8.8	8.8	8.8	8.9	10.1	10.1	10.0	10.1	11.4	11.4	11.4	11.5	13.0	13.0	13.0	13.0	14.8	14.8	14.8	14.9	
Hi PR		248	249	251	255	289	290	292	296	334	335	336	341	382	383	385	389	435	436	438	442	492	493	495	500	
Lo PR		136	140	147	159	139	143	151	162	142	146	153	164	143	147	154	165	143	147	154	166	145	148	156	167	

IDB\*: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Airflow may vary depending on actual ambient conditions and system operation modes.

Shaded area is AHRI conditions

kW = Total system power

Amps = outdoor unit amps

EXPANDED HEATING DATA — NORMAL HEATING MODE

DH9VSA241CA\* + CAHEA3630\*3A\*, MBVK16CH\*X00A\*

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	31.3	29.1	27.1	25.2	24.0	23.3	21.5	41.8	38.9	36.0	33.2	31.5	30.5	27.8	24.0	22.6	20.1	15.9
T/R	31	29	27	25	24	23	21	42	39	36	33	32	30	28	25	22	20	16
KW	1.74	1.72	1.71	1.69	1.68	1.56	1.54	3.77	3.63	3.48	3.34	3.26	3.21	3.08	2.93	2.83	2.72	2.34
AMPS	5.4	5.4	5.3	5.2	5.2	5.1	5.1	14.9	14.3	13.7	13.0	12.7	12.5	11.9	11.3	10.8	10.3	8.6
COP	5.62	5.29	4.96	4.67	4.48	4.37	4.09	3.25	3.14	3.03	2.91	2.83	2.78	2.65	2.40	2.34	2.17	1.99

DH9VSA361CA\* + CAHEA3630\*3A\*, MBVK16CH\*X00A\*

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	45.2	42.2	39.3	36.5	34.2	33.8	31.3	57.3	53.2	49.3	45.5	43.2	41.7	38.3	34.2	31.2	26.6	18.9
T/R	28	26	24	22	21	20	19	35	33	30	28	26	25	23	21	19	16	11
KW	2.46	2.45	2.43	2.41	2.39	2.30	2.27	5.22	5.04	4.85	4.68	4.57	4.50	4.34	4.18	3.98	3.62	2.81
AMPS	8.0	7.9	7.8	7.7	7.7	7.6	7.5	20.6	19.7	18.9	18.2	17.7	17.4	16.7	15.9	15.1	13.5	9.9
COP	5.57	5.21	4.90	4.58	4.34	4.31	4.04	3.22	3.09	2.98	2.85	2.77	2.72	2.58	2.40	2.30	2.15	1.98

Calculations are based on nominal CFM and 70 °F indoor dry bulb.

Amps = Outdoor unit amps (comp.+fan)

Note: Shaded area is AHRI Rating Conditions at 47°F outdoor ambient temperature

KW= Total system power



DH9VSA241CA\* + CAHEA3630\*3A\*, MBVK16CH\*X00A\*

	OUTDOOR AMBIENT TEMPERATURE							
	65	60	55	50	47	45	40	35 OR LOWER
MBh	55.8	52.1	51.2	47.6	45.6	44.3	41.1	Same as normal heating mode
T/R	31	29	28	26	25	24	22	
KW	3.24	3.20	3.38	3.32	3.28	3.26	3.19	
AMPS	11.3	11.1	11.9	11.7	11.5	11.4	11.1	
COP	5.05	4.77	4.44	4.20	4.07	3.98	3.77	

DH9VSA361CA\* + CAHEA3630\*3A\*, MBVK16CH\*X00A\*

	OUTDOOR AMBIENT TEMPERATURE							
	65	60	55	50	47	45	40	35 OR LOWER
MBh	70.1	65.6	64.5	60.2	57.7	56.0	52.2	Same as normal heating mode
T/R	44	41	40	38	36	35	32	
KW	4.86	4.71	4.98	4.81	4.72	4.65	4.50	
AMPS	18.9	18.2	19.4	18.7	18.3	18.0	17.4	
COP	4.23	4.08	3.80	3.67	3.58	3.53	3.40	

Calculations are based on nominal CFM and 70 °F indoor dry bulb.  
**Note:** Shaded area is AHRI Rating Conditions at 47°F outdoor ambient temperature

Amps = Outdoor unit amps (comp. +fan)  
 KW= Total system power

PERFORMANCE DATA FOR STANDARD OPERATING MODE

DH9VSA241CA* / CAHEA3630*3A*, MBVK16CH*X00A* DESIGN SUBCOOLING @ AHRI 95°F CONDITIONS 5-7°F AT 100% DEMAND				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	26,100	19,600	6,500	1,470
80°	25,700	19,700	6,000	1,600
85°	25,300	19,700	5,600	1,710
90°	24,700	19,500	5,200	1,800
<b>95°</b>	<b>24,000</b>	<b>19,200</b>	<b>4,800</b>	<b>1,970</b>
100°	23,200	18,800	4,400	2,100
105°	22,400	18,400	4,000	2,280
110°	21,700	18,400	3,300	2,500
115°	21,000	18,300	2,700	2,640
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	23,100	18,700	4,400	1,970

DH9VSA241CA* / CAHEA3630*3A*, MBVK16CH*X00A* DESIGN SUBCOOLING @ AHRI 95°F CONDITIONS 5-7°F IN BOOST MODE				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	26,100	19,600	6,500	1,470
80°	25,700	19,700	6,000	1,600
85°	25,300	19,700	5,600	1,710
90°	24,700	19,500	5,200	1,800
<b>95°</b>	<b>24,000</b>	<b>19,200</b>	<b>4,800</b>	<b>1,970</b>
100°	23,200	18,800	4,400	2,100
105°	22,400	18,400	4,000	2,280
110°	21,700	18,400	3,300	2,500
115°	21,000	18,300	2,700	2,640
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	23,100	18,700	4,400	1,970

DH9VSA361CA* / CAHEA3630*3A*, MBVK16CH*X00A* DESIGN SUBCOOLING @ AHRI 95°F CONDITIONS 9-11°F AT 100% DEMAND				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	38,100	30,100	8,000	2,200
80°	37,300	29,800	7,500	2,400
85°	36,400	29,500	6,900	2,510
90°	35,300	28,800	6,500	2,700
<b>95°</b>	<b>34,200</b>	<b>28,000</b>	<b>6,200</b>	<b>2,850</b>
100°	32,900	27,100	5,800	3,000
105°	31,600	26,200	5,400	3,240
110°	30,400	25,700	4,700	3,500
115°	29,200	25,100	4,100	3,700
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	32,900	27,300	5,600	2,860

DH9VSA361CA* / CAHEA3630*3A*, MBVK16CH*X00A* DESIGN SUBCOOLING @ AHRI 95°F CONDITIONS 9-11°F IN BOOST MODE				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	41,000	31,200	9,800	2,200
80°	40,200	30,900	9,300	2,300
85°	39,200	30,400	8,800	2,500
90°	38,000	29,600	8,400	2,600
<b>95°</b>	<b>36,000</b>	<b>28,800</b>	<b>7,900</b>	<b>3,000</b>
100°	35,400	28,400	7,000	3,400
105°	34,000	26,800	7,200	3,100
110°	32,600	26,200	6,400	3,400
115°	31,500	26,000	5,500	3,600
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	35,400	28,000	7,400	2,800

NORMAL MODE - COOLING		SOUND POWER LEVEL <sup>1</sup>						
TONNAGE	TOTAL UNIT SOUND RATING (dBA)	OCTAVE BAND SPECTRUM FREQUENCY (Hz) ANALYSIS (dB)						
		125	250	500	1000	2000	4000	8000
2-ton	71	71.8	70.9	70.4	65.6	60.4	51.5	43.7
3-ton	71	71.8	71.7	70.2	65.7	60.5	51.7	44.6

<sup>1</sup>Compliant with AHRI 270.<sup>2</sup>Compliant with AHRI 220.

NORMAL MODE - HEATING		SOUND POWER LEVEL <sup>1</sup>						
TONNAGE	TOTAL UNIT SOUND RATING (dBA)	OCTAVE BAND SPECTRUM FREQUENCY (Hz) ANALYSIS (dB)						
		125	250	500	1000	2000	4000	8000
2-ton	75	76.1	76.7	73.8	69.1	63.8	56.0	48.4
3-ton	75	76.1	76.7	73.8	69.1	63.8	56.1	49.0

<sup>1</sup>Compliant with AHRI 270.<sup>2</sup>Compliant with AHRI 220.

**QUIET MODE\_COOLING**


TONNAGE	SOUND SUPPRESSION LEVEL	SOUND POWER LEVEL (dBA)1	SOUND PRESSURE LEVEL (dBA)2
2-ton	LV.1	69	53
	LV.2	66	50
	LV.3	63	47
3-ton	LV.1	69	53
	LV.2	66	50
	LV.3	63	47

<sup>1</sup> Quiet Mode Sound Power and Sound Pressure levels determined at a distance of 3 [ft].

**QUIET MODE\_HEATING**

TONNAGE	SOUND SUPPRESSION LEVEL	SOUND POWER LEVEL (dBA)1	SOUND PRESSURE LEVEL (dBA)2
2-ton	LV.1	72	56
	LV.2	69	53
	LV.3	66	50
3-ton	LV.1	72	56
	LV.2	69	53
	LV.3	66	50

<sup>1</sup> Quiet Mode Sound Power and Sound Pressure levels determined at a distance of 3 [ft].

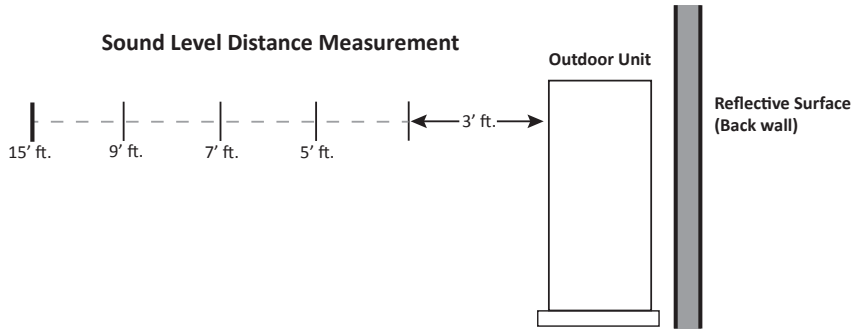

		SOUND PRESSURE (dBA) COOLING MODE <sup>1</sup>				
		DISTANCE FROM PROPERTY LINE				
TONNAGE	REFLECTIVE SURFACE QTY.	3'	5'	7'	9'	15'
2.0 Ton	0	64	59	56	54	50
	1	67	62	59	57	53
	2	70	65	62	60	56
3.0 Ton	0	64	59	56	54	50
	1	67	62	59	57	53
	2	70	65	62	60	56


<sup>1</sup> Compliant with AHRI 275 utilizing standard mode, total sound levels

		SOUND PRESSURE (dBA) HEATING MODE <sup>1</sup>				
		DISTANCE FROM PROPERTY LINE				
TONNAGE	REFLECTIVE SURFACE QTY.	3'	5'	7'	9'	15'
2.0 Ton	0	68	63	60	58	54
	1	71	66	63	61	57
	2	74	69	66	64	60
3.0 Ton	0	68	63	60	58	54
	1	71	66	63	61	57
	2	74	69	66	64	60

<sup>1</sup> Compliant with AHRI 275 utilizing standard mode, total sound levels

***ALL AHRI SYSTEM RATINGS ARE ACCESSIBLE IN THE UNITARY MATCHUP TOOL VIA  
DAIKIN CITY OR IN THE DAIKIN SYSTEM CONFIGURATOR TOOL VIA PARTNERLINK.***

MODEL	DIMENSIONS		
	W"	D"	H"
DH9VSA241CA*	37	12 $\frac{5}{8}$	56 $\frac{5}{16}$
DH9VSA361CA*	37	12 $\frac{5}{8}$	56 $\frac{5}{16}$

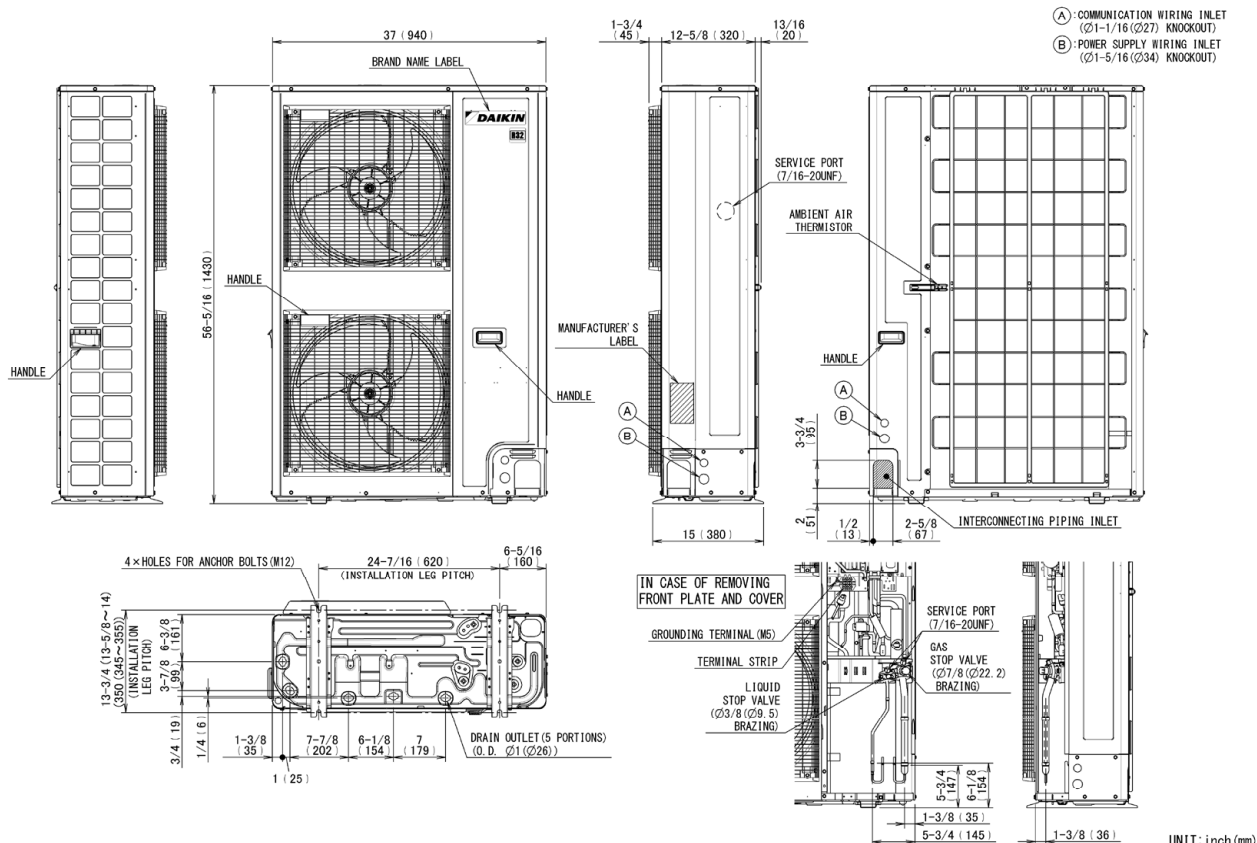





MODEL	DESCRIPTION	DH9VSA 241CA*	DH9VSA 361CA*
KPW5G112	Wind Baffle	X	X
3K020967-2 <sup>1</sup>	Snow Guard Front	X	X
3P434587-5 <sup>1</sup>	Snow Guard Rear	X	X
3P434588-1 <sup>1</sup>	Snow Guard Side	X	X
0270R02063 (130-DK-017)	Hail Guard	X	X
KEH3P648291	Drain Pan Heater	X	X
DSEN-HAQA	Daikin One Home Air Monitor	X	X

<sup>1</sup> Product is manufactured at time of order. Lead time will be associated with purchase.





